

澳門科技大學

MACAU UNIVERSITY OF SCIENCE AND TECHNOLOGY

澳門氹仔偉龍馬路

電話：(+853)2888 1122 傳真：(+853)2888 0022

網址：www.must.edu.mo



Avenida Wai Long, Taipa, Macau

Tel: (+853)2888 1122 Fax: (+853)2888 0022

Website: www.must.edu.mo

Contact: Macau Gentlement Limited
Client: City of Dreams-Morpheus
Address: Estrade do Istmo, Cotai, Macau

Samples Were collected on 3 separate days:

On 26th June, Control and test samples(T) were collected to evaluate bactericidal performance

On 29th June, test2(T+3) were collected to evaluate bactericidal performance

On 03rd July, test3(T+7) were collected to evaluate bactericidal performance

Methods

Unit representation	Colony-forming unit (CFU)
Experimental method description	Bacteria grow on plate solid medium by smearing method, actually count the number of real colonies
Data interpretation instructions	Presume that each colony is formed by the propagation of a single bacterium, directly count the number of colonies on the plate to infer the number of colonies
Data interpretation comparison	CFU is the true value

Microbiology Supervisor

澳門科技大學

MACAU UNIVERSITY OF SCIENCE AND TECHNOLOGY

澳門氹仔偉龍馬路

電話：(+853)2888 1122 傳真：(+853)2888 0022

網址：www.must.edu.mo



Avenida Wai Long, Taipa, Macau

Tel: (+853)2888 1122 Fax: (+853)2888 0022

Website: www.must.edu.mo

Results:

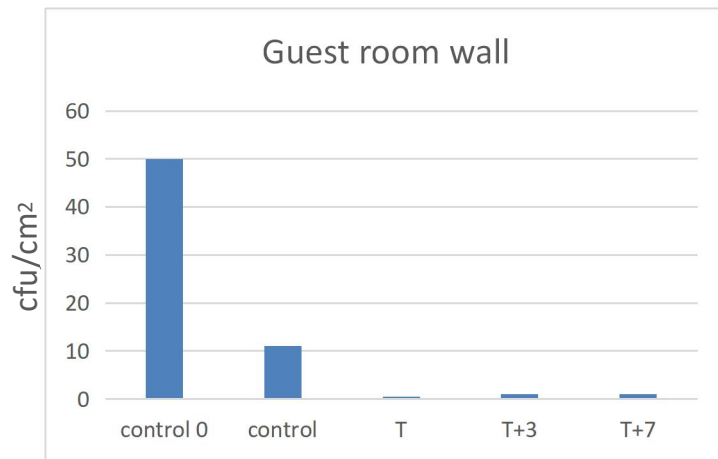
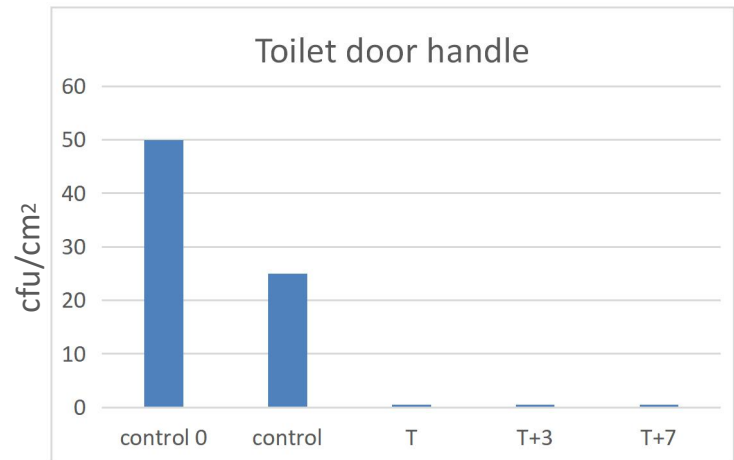
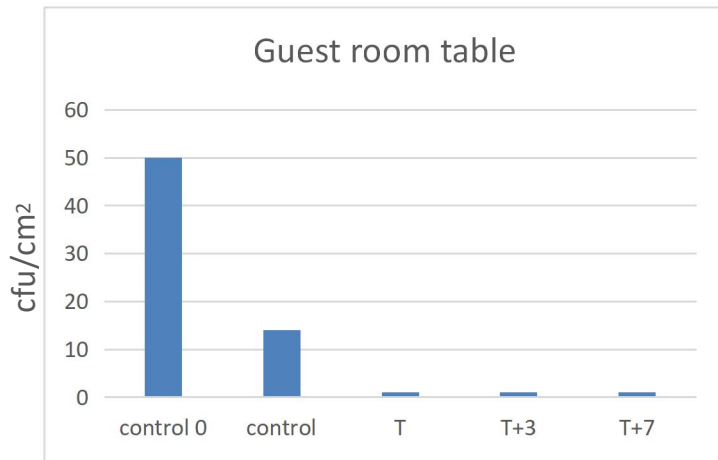


Figure1: Anti-microbial ability of GERMAGIC Thyme Coating

Microbiology Supervisor

澳門科技大學

MACAU UNIVERSITY OF SCIENCE AND TECHNOLOGY

澳門氹仔偉龍馬路

電話：(+853)2888 1122 傳真：(+853)2888 0022

網址：www.must.edu.mo



Avenida Wai Long, Taipa, Macau

Tel: (+853)2888 1122 Fax: (+853)2888 0022

Website: www.must.edu.mo

Results:

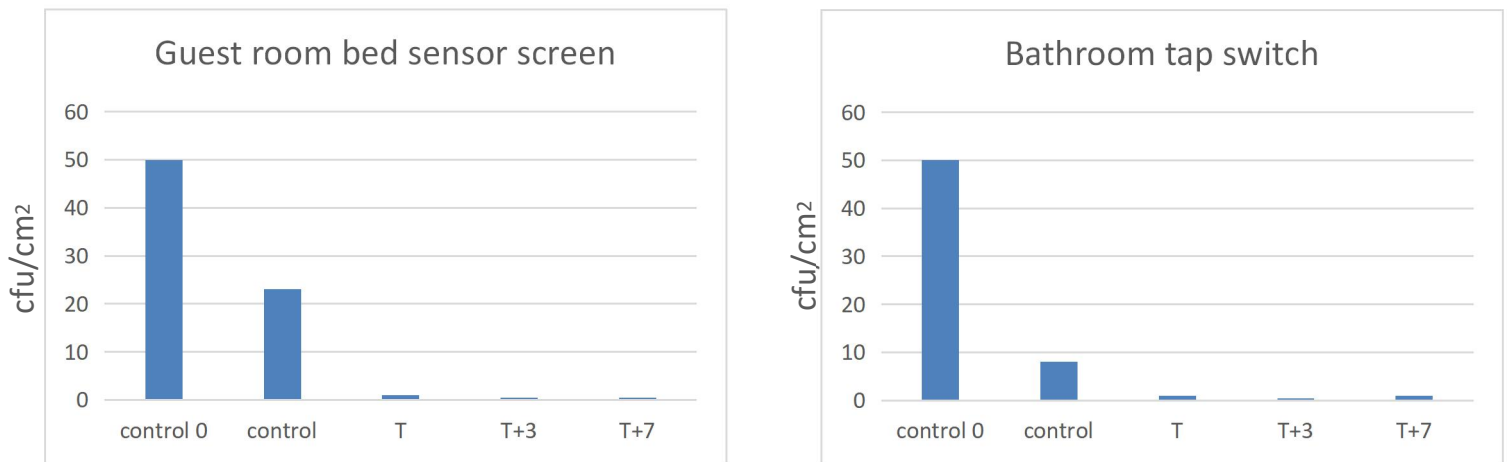


Figure2: Anti-microbial ability of GERMAGIC Thyme Coating

Conclusion:

According to the 8-day sampling inspection, preliminary tests and repeated tests have shown that the coating has the ability to prevent the invasion of microorganisms under strong cleaning in the hotel environment. The total bacterial content in the National food safety standard food microbiological examination: General guidelines does not exceed 10 cfu/cm², so it meets the national health standard.

Microbiology Supervisor